



FIGURE 1UW

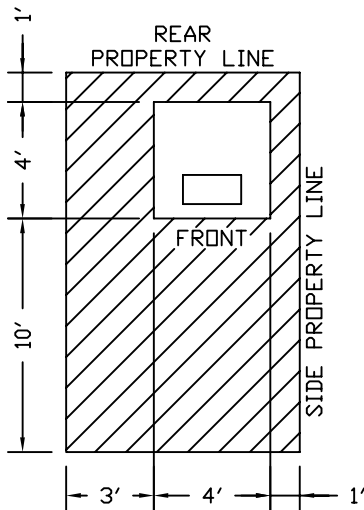

RESIDENTIAL SUBDIVISION

SINGLE-PHASE TRANSFORMER FOR
RESIDENTIAL SUBDIVISION
INSTALLATION

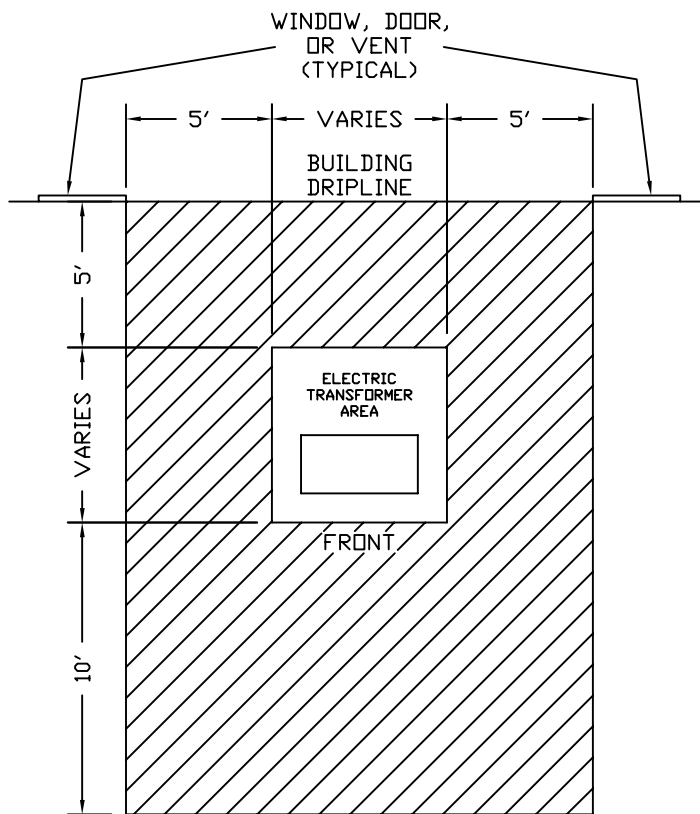

SEE NOTE (5)

SINGLE-PHASE RESIDENTIAL/COMMERCIAL
THREE-PHASE COMMERCIAL

SINGLE-PHASE TRANSFORMER OR
THREE-PHASE TRANSFORMER OR COMBINATION
THREE-PHASE TRANSFORMER AND SECONDARY
TERMINATION ENCLOSURE FOR COMMERCIAL
INSTALLATION

NOTES

- (1) TRANSFORMERS CAN BE A FIRE HAZARD SINCE THEY CONTAIN FLAMMABLE OIL.
- (2) THE ABOVE DIMENSIONS ALLOW ACCESS FOR OPERATION AND MAINTENANCE.
- (3) PERMANENT OBSTRUCTION WITHIN OR ABOVE THE HATCHED WORKING SPACE IS PROHIBITED.
- (4) GUARD POSTS ARE REQUIRED IN TRAFFIC AREA.
- (5) GATE (VENTED) REQUIRED IF TRANSFORMER IS TO BE INSTALLED WITHIN AN ENCLOSURE. GATE MUST BE A MINIMUM OF TWO FEET WIDER THAN TRANSFORMER AND MUST INCLUDE PROVISION FOR A UNITED POWER PADLOCK. CONTACT UNITED POWER FOR TRANSFORMER DIMENSIONS AND SITE SPECIFIC REQUIREMENTS.



ISSUED	
APPROVAL	
APPROVAL	
DATE	BY REVISIONS
06/07	ER NEW DRAWING
12/07	ER



UNITED POWER, INC.
P.O. BOX 929 • BRIGHTON, CO. 80601

MINIMUM WORKSPACE
ELECTRIC PADMOUNT TRANSFORMERS