


FIGURE 2M

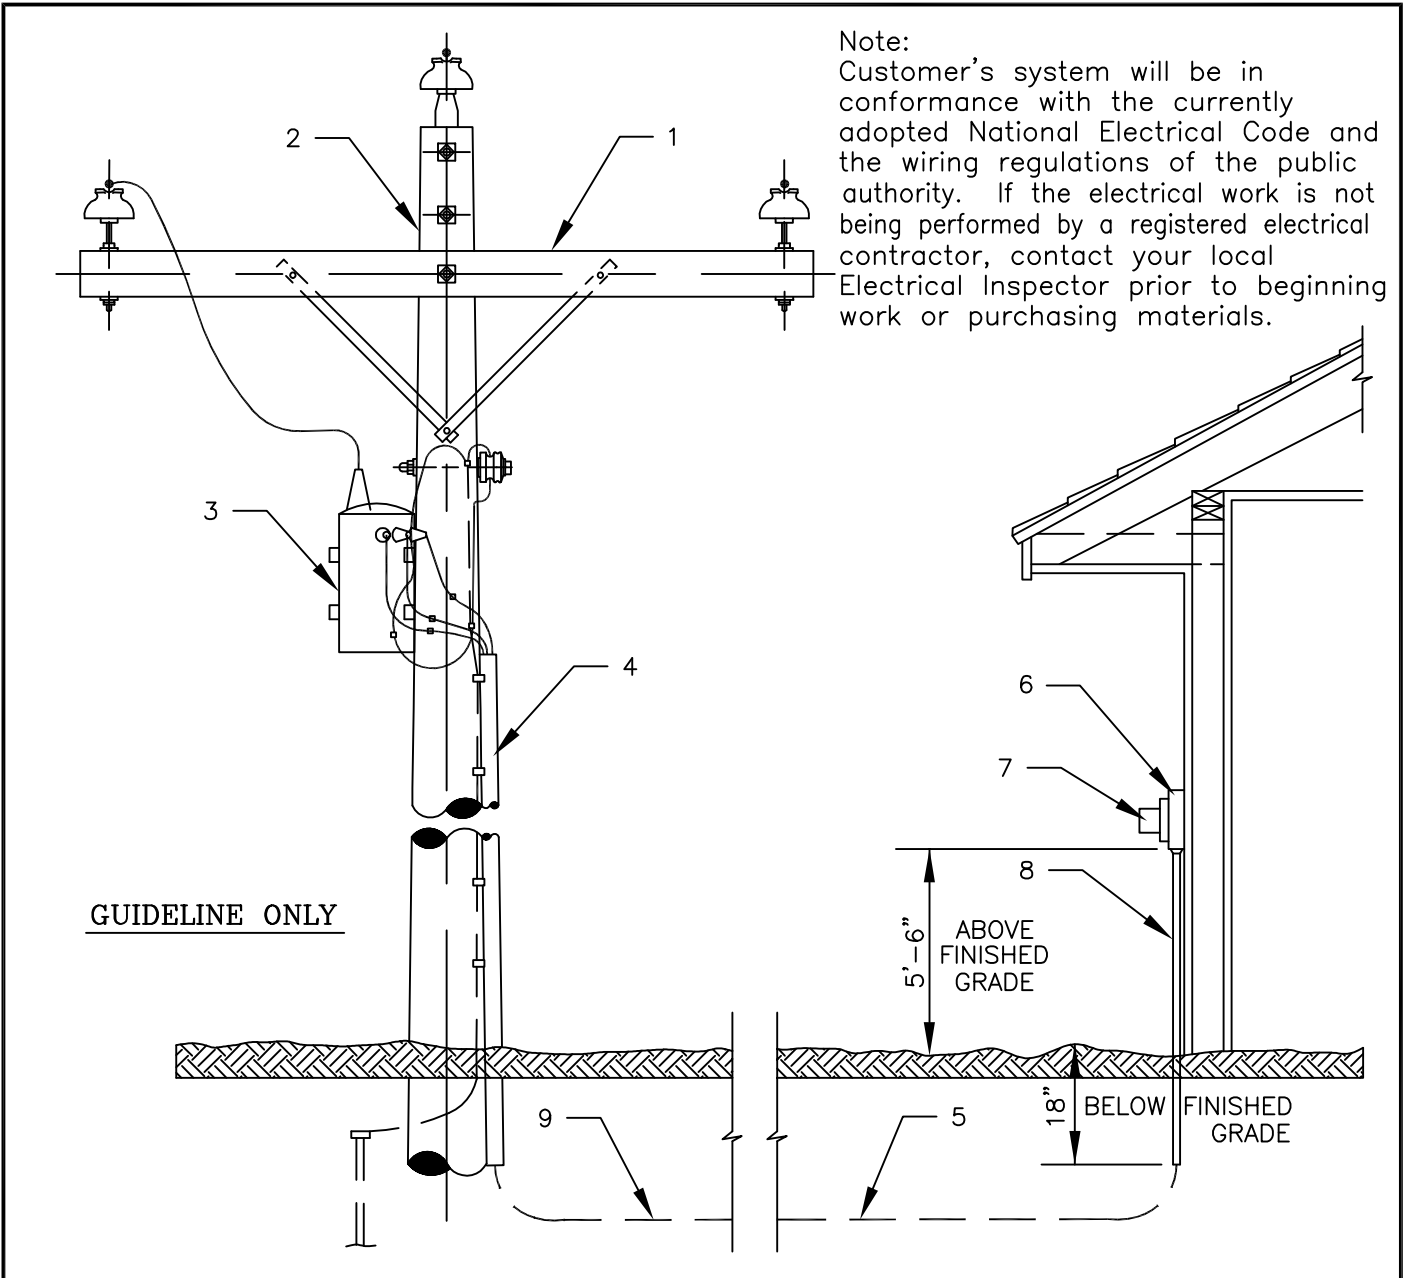

Note:
Customer's system will be in conformance with the currently adopted National Electrical Code and the wiring regulations of the public authority. If the electrical work is not being performed by a registered electrical contractor, contact your local Electrical Inspector prior to beginning work or purchasing materials.

GUIDELINE ONLY

ITEM	NO.	MATERIAL	ITEM	NO.	MATERIAL
1	1	Primary assembly, as required	9		Trench
2	1	Pole, as required			
3	1	Transformer, as required			
4	1	Conduit riser and wires, as required			
5		Underground cable			
6	1	Meter socket			
7	1	Watt hour meter			
8		Service entrance conduit			

ITEM 1, 2, 3, 4, 5, 7, 9 FURNISHED AND INSTALLED BY UNITED POWER.
ITEMS 6, 8 FURNISHED AND INSTALLED BY CUSTOMER.



UNITED POWER, INC.
P.O. BOX 929 • BRIGHTON, CO. 80601

ENG. APPROVAL: _____ DATE: _____
OPER. APPROVAL: _____ DATE: _____

DWN BY: KH
ISSUED BY:
ISSE DT:

UNDERGROUND
SERVICE-TRANSFORMER
POLE TO METER-ON-HOUSE