


FIGURE 3M

Note: Customer's system will be in conformance with the currently adopted National Electrical Code and the wiring regulations of the public authority. If the electrical work is not being performed by a registered electrical contractor, contact your local Electrical Inspector prior to beginning work or purchasing materials.

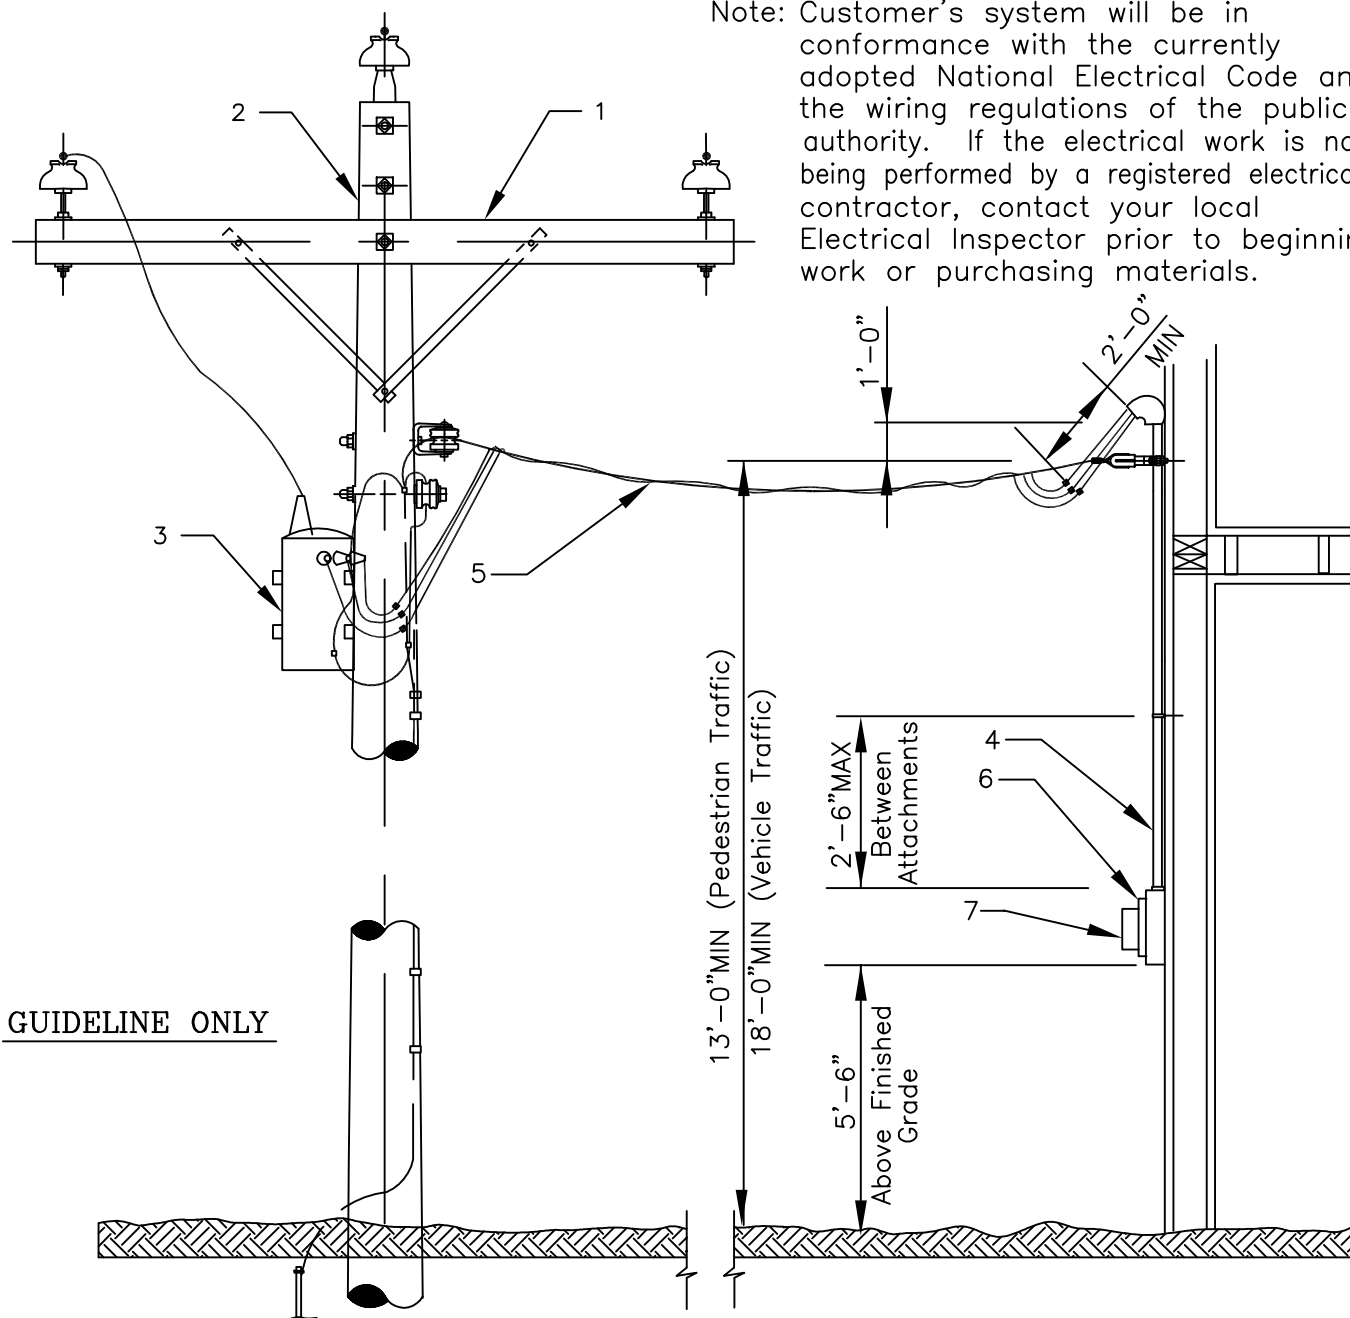

GUIDELINE ONLY

ITEM NO.	MATERIAL	ITEM NO.	MATERIAL
1 1	Primary assembly, as required		
2 1	Pole, as required		
3 1	Transformer, as required		
4 1	Service entrance conduit & wires		
5	Overhead cable		
6 1	Meter socket		
7 1	Watt hour meter		

ITEM 1, 2, 3, 5, 7, FURNISHED AND INSTALLED BY UNITED POWER.
ITEMS 4, 6 FURNISHED AND INSTALLED BY CUSTOMER.



UNITED POWER, INC.
P.O. BOX 929 • BRIGHTON, CO. 80601

DWN BY: KH

ISSUED BY:

ISSE DT:

OVERHEAD SERVICE
TRANSFORMER POLE TO METER
ON COMMERCIAL BUILDING

ENG. APPROVAL:

DATE:

OPER. APPROVAL:

DATE: