


# FIGURE 8M

**Notes:**

1. Customer's system shall be in conformance with current National Electric Code and the wiring requirements of the local governing public authority.
2. Service entrance shall be schedule 80 continuous pipe (no couplings above grade, flush with wall and vertically plum (maximum 1/2 inch variance per 3 foot rise)
3. Factory-made slip joint conduit is acceptable if allowed by local governing public authority.
4. Conduit straps are acceptable if allowed or required by local governing public authority.
5. If the electrical work is not being performed by a licensed Electrical Contractor, contact your local Electrical Inspector prior to beginning work or purchasing materials.

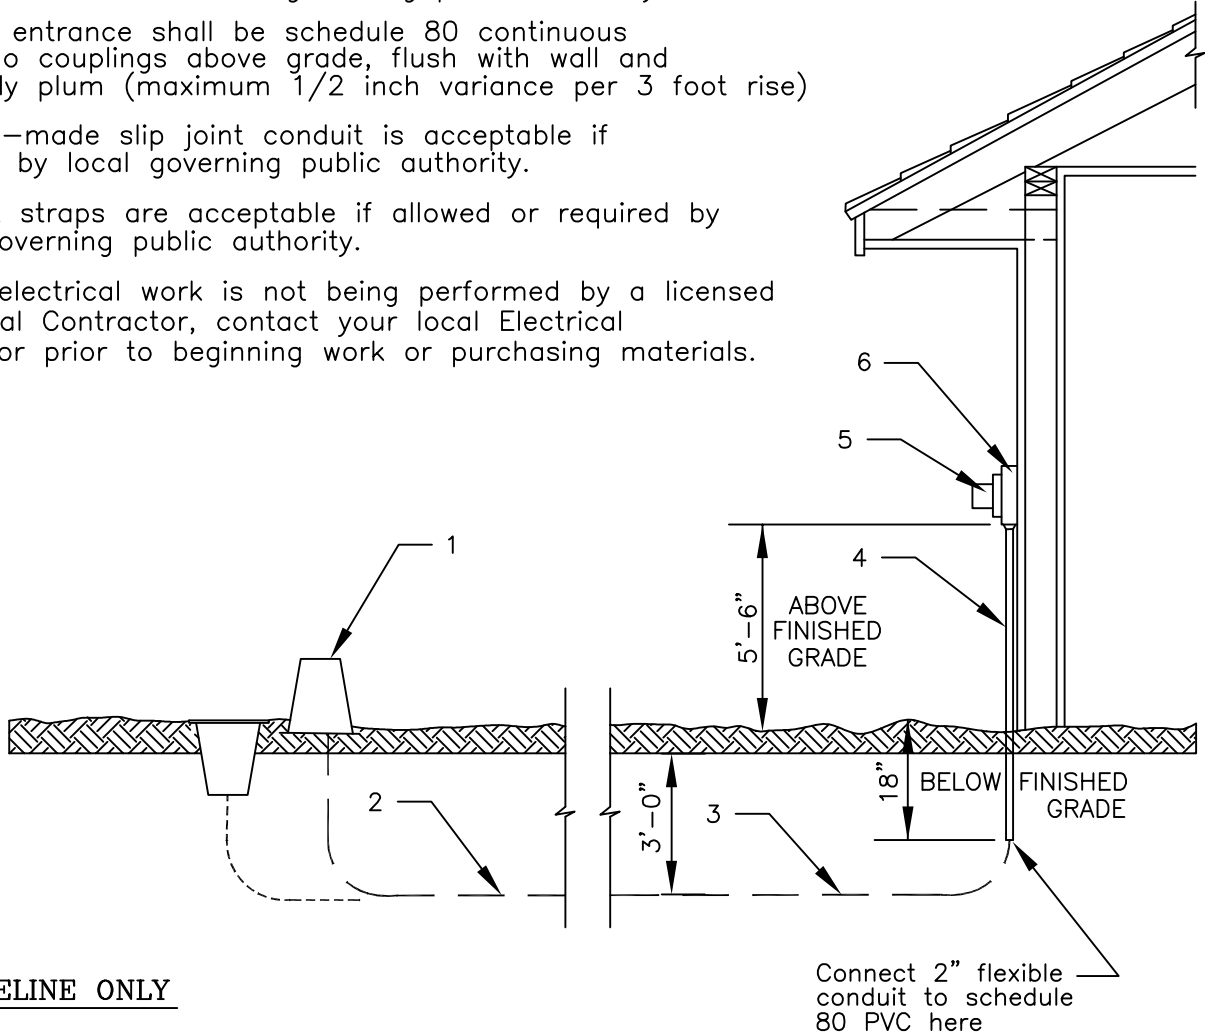


GUIDELINE ONLY

ITEM	NO.	MATERIAL	ITEM	NO.	MATERIAL
1	1	Secondary pedestal			
2		Trench			
3		Underground cable in flexible conduit			
4		Service entrance conduit			
5	1	Watt hour meter			
6	2	Meter socket			

ITEMS 1, 2, 3, 5, FURNISHED AND INSTALLED BY UNITED POWER.  
 ITEMS 4, 6 FURNISHED AND INSTALLED BY CUSTOMER.

ENG. APPROVAL:	DATE:
OPER. APPROVAL:	DATE:



**UNITED POWER, INC.**  
 P.O. BOX 929 • BRIGHTON, CO. 80601

DWN BY: KH	<b>UNDERGROUND                  SERVICE- SECONDARY PEDESTAL                  TO METER-ON-HOUSE</b>
ISSUED BY:	
ISSE DT:	