


FIGURE 9M

Notes:

1. Customer's system will be in conformance with the currently adopted National Electrical Code and the wiring regulations of the public authority.
2. If the electrical work is not being performed by a registered electrical contractor, contact your local Electrical Inspector prior to beginning work or purchasing materials.

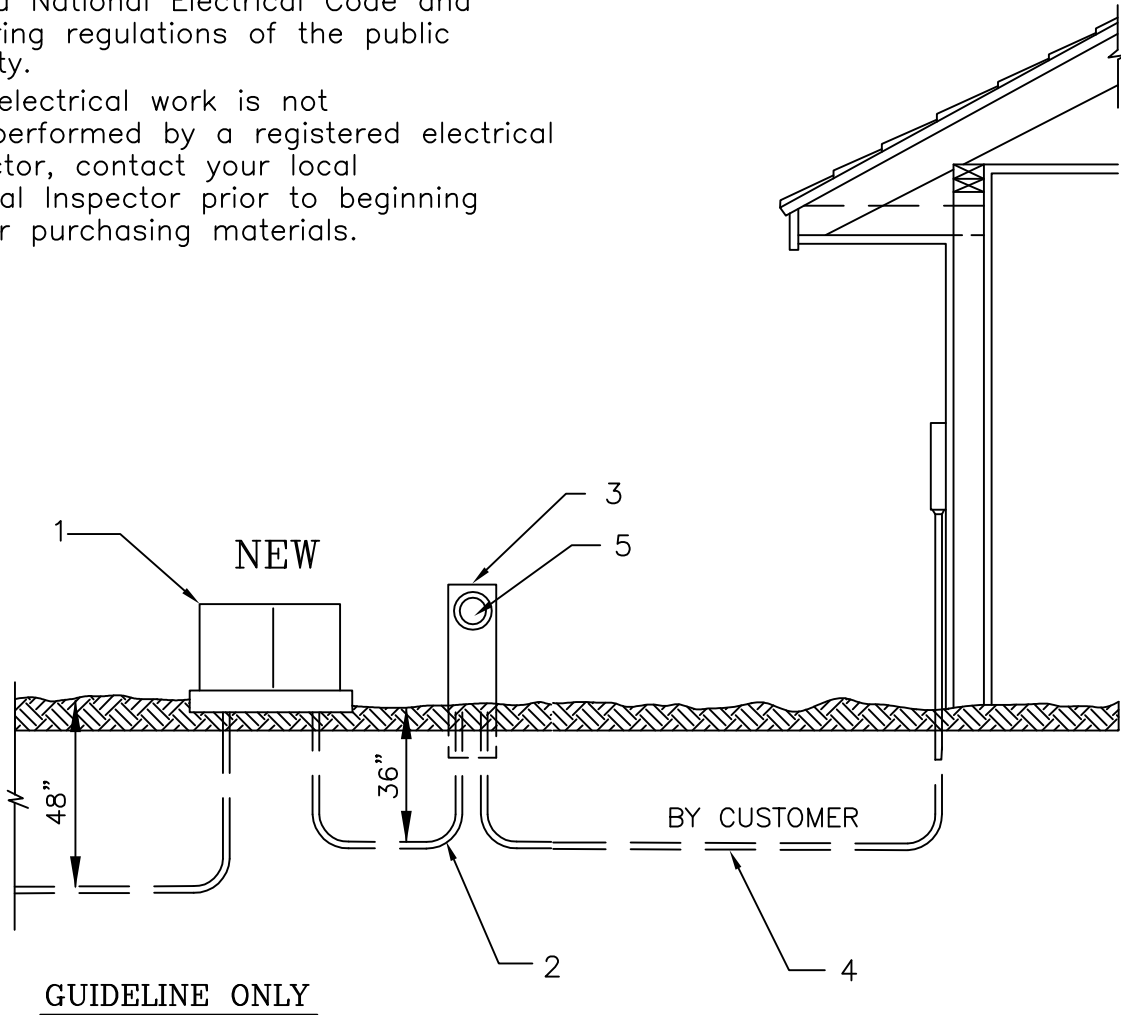

ITEM	NO.	MATERIAL	ITEM	NO.	MATERIAL
1		Electric Transformer			
2		Underground Secondary Cable			
3		Trough Type Meter Pedastal			
4		Underground Service Cable			
5		Watt Hour Meter			

ITEM 1, 2, 3, 5, FURNISHED AND INSTALLED BY UNITED POWER. ITEM 4 FURNISHED AND INSTALLED BY CUSTOMER.		<p style="margin: 0;">UNITED POWER, INC. P.O. BOX 929 • BRIGHTON, CO. 80601</p>	
ENG. APPROVAL: _____ DATE: _____		DWN BY: A.Y.S ISSUED BY: _____	
OPER. APPROVAL: _____ DATE: _____		ISSUED DT: _____ <p style="text-align: center; margin: 0;">UNDERGROUND SERVICE TRANSFORMER TO TROUGH TYPE METER PEDESTAL</p>	